Panasonic

ECO-i™ Submittal Data

CZ-ESWC2

Schedule Timer

Job Name: _____
Location: _____
Engineer: _____
Submitted to: _____
Submitted by: _____
Reference: _____

Approval: _____
Date: _____
Construction: _____
Unit#: _____
Drawing#: _____

Features / Benefits
Timer Controls up to 64 Units into 1, 4, or 8 Groups
7 Day Timer, 6 Time Periods/Day
100 Hour Backup Battery

Applications
Hotel Rooms
Assisted Living
Offices
Dorm Rooms

Data is Subject to Change.

Dimensions

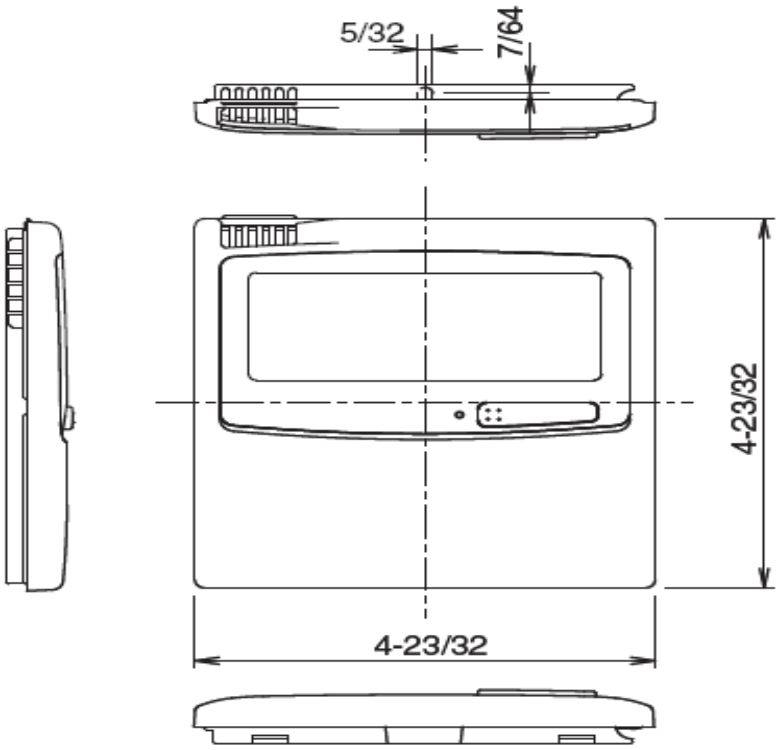

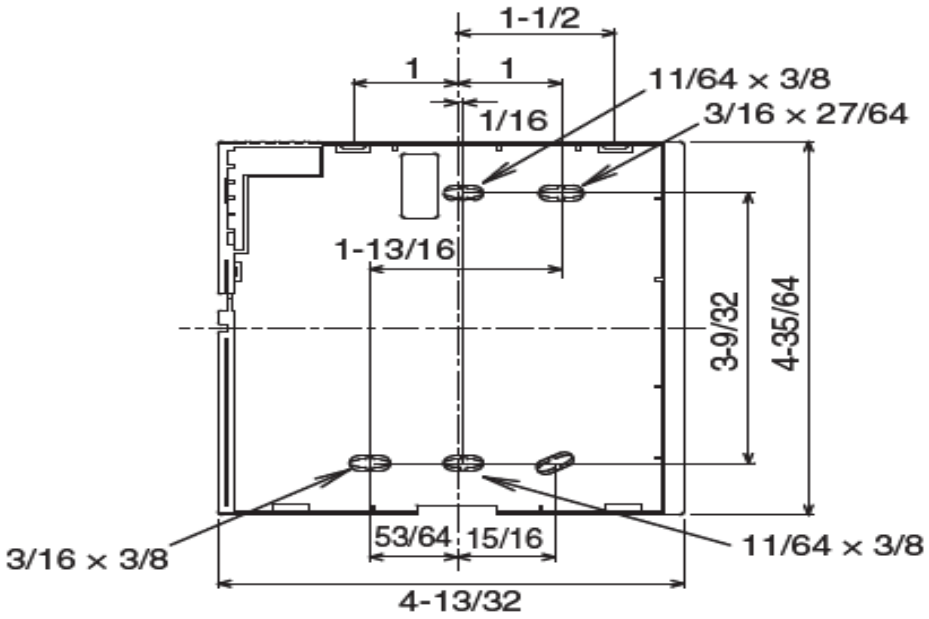

Panasonic

Panasonic North America
Air Conditioning Division
1690 Roberts Blvd., NW, Suite 110
Kennesaw, GA 30144
http://www.panasonic.com/aircon